

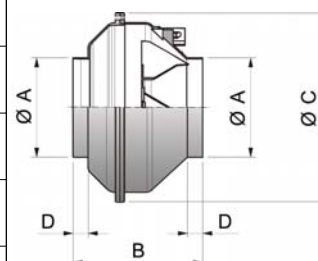


Submittal Data

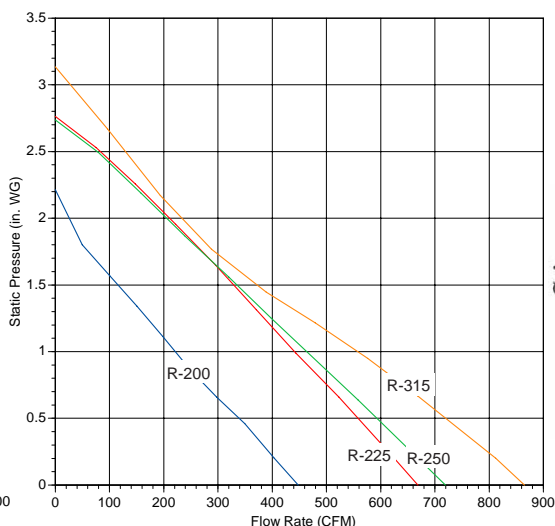

Flow Rate (CFM)				Flow Rate (CFM)										Static Pressure (inches W.G)				Dimensions (inches)			
Model	Duct Dia	Volts	Current Amp	0.0"	0.2"	0.4"	0.6"	0.8"	1.0"	1.5"	2.0"	2.5"	3.0"	Max Sp	A	B	C	D			
R-100*	4"	115	0.23	141	120	100	78	46	-	-	-	-	-	0.975"	4.0	9.7	11.3	1.2			
R-110	4"	115	0.74	173	162	150	139	125	115	77	15	-	-	2.213"	4.0	9.7	11.3	1.2			
R-125	5"	115	0.78	265	244	220	200	170	150	80	-	-	-	2.001"	5.0	9.7	11.3	1.2			
R-150*	6"	115	0.78	368	332	286	248	190	163	55	-	-	-	1.686"	6.0	9.0	14.9	1.2			
R-200*	8"	115	1.00	448	404	350	317	260	225	110	30	-	-	2.213"	8.0	9.0	14.9	1.2			
R-225	8"	115	2.09	669	624	560	540	450	440	330	210	76	-	2.762"	8.0	9.0	14.9	1.2			
R-250	10"	115	2.00	719	669	610	559	520	460	322	200	80	-	2.736"	10.0	9.0	14.9	1.2			
R-315*	12"	115	2.24	865	812	740	700	620	570	388	240	130	37	3.135"	12.0	10.8	17.8	1.2			

*These models are Energy Star rated.

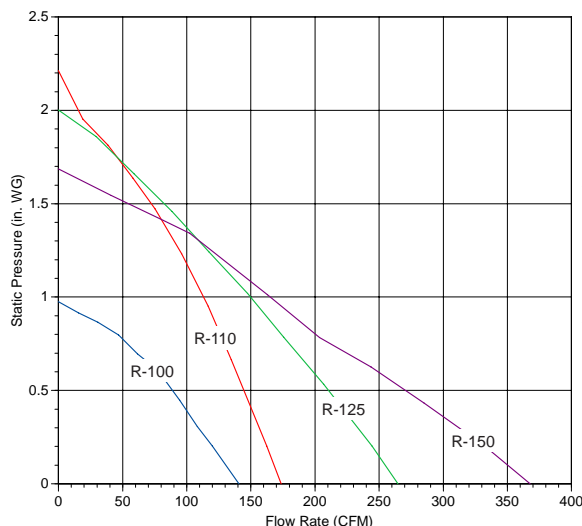

Construction

Fan housing shall be constructed of 5VA UL approved plastic. Integrated air turning vanes shall be provided for optimal air performance. Fan shall be supplied with an integral external electrical terminal box with pre-wired terminal strip connections. Integral disconnect switch shall be provided when specified.

Motor

Motorized impeller shall be an external rotor type, class B insulation totally enclosed PSC Type for maximum efficiency. Motor shall be equipped with automatic reset thermal overload protection and shall be acceptable for continuous duty. Sufficient service factor shall be provided to ensure long maintenance free operation over maximum load conditions.

Wheel

Shall be of backward inclined centrifugal airfoil type with a well designed inlet venturi for maximum air performance. Motorized impeller shall be statically and dynamically balanced as one integral unit to provide for vibration free performance.

Mounting Bracket

Mounting bracket shall have premounting capability and allow for an easy snap-in action during fan installation.

Code Approvals

Fans shall be approved by HVI for air performance.

All R-Series fans are backed by FanAm's 3 year warranty.

PROJECT										ARCHITECT	
CONTRACTOR					DATE		SUBMITTED BY			ENGINEER	
SPECIFICATION											
FAN POS.	MODEL NO.	CFM	IN.WG.	RPM	WATTS	HP	AMPS	dB(A)	SONES	QTY.	OPTIONAL EQUIPMENT

WARNING! DO NOT use in HAZARDOUS ENVIRONMENTS where fan's electrical system could provide ignition to combustible or flammable materials unless it is specifically built for hazardous environments. FanAm reserves the right to substitute material or change product specification.